

General Safety Instructions:



READ SAFETY INSTRUCTIONS

Servicing:

These products are not customer serviceable. TDK-Lambda and their authorised agents only are permitted to carry out repairs.

Critical Components:

These products are not authorised for use as critical components in nuclear control systems, life support systems or equipment for use in hazardous environments without the express written approval of the Managing Director of TDK-Lambda EMEA.

Product Usage:

These products are designed for use within a host equipment which restricts access to authorised competent personnel.

This product is a component power supply and is only to be installed by qualified persons within other equipment and must not be operated as a stand-alone product.

This product is for sale to business to business customers and can be obtained via distribution channels. It is not intended for sale to end users.

This product is a component power supply and complies with the EMC directive. The EMC performance of a component power supply will be affected by the final installation, compliance to the stated EMC standards and conformance to the EMC Directive must be confirmed after installation by the final equipment manufacturer.

For guidance with respect to test conditions please visit our website at https://emea.tdk-lambda.com/EMC_guidance or contact your local TDK-Lambda sales office.

Environmental:

These products are IPX0, and therefore chemicals/solvents, cleaning agents and other liquids must not be used.

Environment:

This power supply is a switch mode power supply for use in applications within a Pollution Degree 2, overvoltage category II environment. Material Group IIIb PCB's are used within it.

Output Loading:

The output power taken from the power supply must not exceed the rating stated on the power supply label, except as stated in the product limitations in this handbook.

Input Parameters:

This product must be operated within the input parameters stated in the product limitations in this handbook.

End of Life Disposal:

The unit contains components that require special disposal. Make sure that the unit is properly disposed of at the end of its service life and in accordance with local regulations.



RISK OF ELECTRIC SHOCK

High Voltage Warning:

Dangerous voltages are present within the power supply. The professional installer must protect service personnel from inadvertent contact with these dangerous voltages in the end equipment.

WARNING: When installed in a Class I end equipment, this product must be reliably earthed and professionally installed.

The (+) or (-) output(s) can be earthed or left floating. The unit cover(s)/chassis must not be made user accessible. The mains input connector is not acceptable for use as field wiring terminals. Do not use mounting screws, which penetrate the unit more than 3mm (FPS/RFE1000), 6mm (HFE/RFE1600/2500 & racks). Special earthing screws are used on these products which connect the cover to the chassis. They must not be removed. If they are removed by mistake, they must be replaced with new ones and the product tested for earth bonding.

This unit must be securely mounted and its earth terminal/baseplate properly bonded to the main protective earth

before any connection to the MAINS supply is made. An internal fuse protects the unit and must not be replaced by the user. In case of internal defect, the unit must be returned to TDK-Lambda or one of their authorised agents. A suitable mechanical, electrical and fire enclosure must be provided by the end use equipment for mechanical, electric shock and fire hazard protection.

Energy Hazards:

Certain modules are capable of providing hazardous energy (240VA) according to output voltage setting. Final equipment manufacturers must provide protection to service personnel against inadvertent contact with these module output terminals. If set such, that hazardous energy can occur, then the module terminals or connections must not be user accessible.

Disconnect device: An appropriate disconnect device shall be incorporated in the building installation wiring. Refer to the user manual of the specific model for more details.

Rack mounting safety instructions:

A) Elevated Operating Ambient - If installed in a closed or multi-unit rack assembly, the operating ambient temperature of the rack environment may be greater than room ambient. Therefore, consideration should be given to installing the equipment in an environment compatible with the maximum ambient temperature (T_{ma}) specified by the manufacturer.

B) Reduced Air Flow - Installation of the equipment in a rack should be such that the amount of air flow required for safe operation of the equipment is not compromised.

C) Mechanical Loading - Mounting of the equipment in the rack should be such that a hazardous condition is not achieved due to uneven mechanical loading.

D) Circuit Overloading - Consideration should be given to the connection of the equipment to the supply circuit and the effect that overloading of the circuits might have on overcurrent protection and supply wiring. Appropriate consideration of equipment nameplate ratings should be used when addressing this concern.

E) Reliable Earthing - Reliable earthing of rack-mounted equipment should be maintained. Particular attention should be given to supply connections other than direct connections to the branch circuit (e.g. use of power strips).



HOT SURFACE

External Hot Surfaces:

In accordance with local regulations for Health and Safety at work, manufacturers have an obligation to protect service engineers as well as users. In order to comply with this, a label must be fitted to these products which is clearly visible to service personnel accessing the overall equipment, and which legibly warns that surfaces of these products may be hot and must not be touched when the products are in operation.

The unit may be mounted in any orientation except inverted (mounted on its top) or vertical with the airflow downwards. The ventilation openings on these products must not be impeded. Ensure that there is at least 50mm spacing between any obstruction and the ventilation openings.

The unit cover/chassis is designed to protect skilled personnel from hazards. They must not be used as part of the external covers of any equipment where they may be accessible to operators, since under full load conditions, part or parts of the unit chassis may reach temperatures in excess of those considered safe for operator access.

HFE2500-S1U RACK INSTRUCTION MANUAL

HFE2500-S1U SERIES RACK SPECIFICATIONS

1	Number of power supply modules (*1)(*7)	---	Maximum 4 units HFE2500 of the same output voltage rating.
2	Maximum output power	W	Refer to HFE2500 specifications
3	Maximum output current	---	320A per output (Total 640A)
4	Input voltage / frequency range (*2)	---	85~265Vac continuous, 47~63Hz, Single phase, separate input for each PS module.
5	Maximum input current (at 115/230Vac)	A	15/12 for each HFE2500 power supply module
6	Maximum line regulation (*4)	%	Less than 0.25 of rated output voltage
7	Maximum load regulation (*5)	%	Less than 0.8 of rated output voltage
8	AC input connector (*6)	---	Separate for each power supply. HFE2500-S1U: IEC inlet, (C20); HFE2500-S1U/TB: Terminal Block.
9	Output terminals	---	Two bus-bars outputs for each output terminal (two sides). Refer to outline drawing.
10	Remote sensing (*3)	V	Possible. Refer to Instruction Manual.
11	Parallel operation	---	Possible. Refer to Instruction Manual.
12	Series operation	---	Possible. Refer to Instruction Manual.
13	Remote On/Off control (INHIBIT)	---	Separate control for each PS unit, by electrical signal or dry contact. "OFF": 0~0.6V or short. "ON": 2~15V or open.
14	Remote On/Off control (ENABLE)	---	Common for all PS units, by electrical signal or dry contact. "ON": 0~0.6V or short. "OFF": 2~15V or open.
15	DC OK signal	---	Separate signal for each PS unit, open collector signal. Maximum sink current: 10mA, Max 15V. Tracking output setting, "LOW" when $V_{out} > 90\% \pm 5\%$ of output voltage setting
16	AC fail signal	---	Separate signal for each PS unit, open collector signal. Maximum sink current: 10mA, Max 15V. "LOW" when input voltage $85\text{Vac} < V_{in} < 270\text{Vac}$.
17	Over Temperature alarm signal	---	Separate signal for each PS unit, open collector signal. Maximum sink current: 10mA, Max 15V. Refer to Instruction Manual
18	Output voltage trimming	---	Common for all PS units, by built-in potentiometer. Refer to Instruction Manual.
19	Output voltage programming	---	Possible, Common for all PS units, by 0~5V signal. Refer to Instruction Manual.
20	Output voltage programming via I ² C interface	---	Possible, Common for all PS units. Refer to Instruction Manual.
21	OCP programming by external voltage	---	Possible, Common for all PS units, by 0~5V signal. Refer to Instruction Manual.
22	OCP programming via I ² C interface	---	Possible, Common for all PS units. Refer to Instruction Manual.
23	Auxiliary power supply	---	11.2~12.5VDC. Maximum output current: 0.5A
24	Operating temperature	---	-10~50°C: 100% load. +50°C to +60°C: Derate 2%/°C of load +60°C to +70°C: Derate 2.5%/°C of load
25	Storage temperature	---	-30~85°C
26	Operating humidity	---	10~90% RH, no condensation.
27	Storage humidity	---	10~95% RH, no condensation.
28	Vibration	---	Built to meet IEC60068-2-64 (Basic Transportation)
29	Shock	---	Built to meet IEC60068-2-27 (Basic Transportation)
30	Applicable safety standards	---	IEC 62368-1 UL62368-1 CSA22.2 No.62368-1 EN62368-1.
31	Withstand voltage	---	Input-Output: 3000Vrms, 1min.
			Input-Ground: 2000Vrms, 1min.
			Output-Ground: 12, 24V models - 500Vrms, 1min
			Output-Ground: 48V model - 2250VDC, 1min.
32	Isolation resistance	---	More than 100Mohm at 25°C and 70% RH. Output-Ground: 500Vdc
33	Weight (Typ) (with accessories)	kg	5.0
34	Size (W*H*D)	---	445x43.6x401mm. Refer to Outline Drawing.

Notes:

- *1 Mixing of PMBus option units ("HFE2500-xx/S") and standard units ("HFE2500-xx") is not allowed.
- *2 For cases where conformance to various safety standards (UL, EN etc.) is required, Input Voltage to be described as 100-240Vac (50/60Hz).
- *3 Maximum voltage drop on load wires: HFE2500-12: 0.25V/wire, HFE2500-24: 0.5V/wire, HFE2500-48: 1V/wire.
- *4 From 85~132Vac or 170~265Vac, constant load.
- *5 From No-load to Rated load, constant input voltage. Measured at the sensing point in Remote sense.
- *6 Use UL approved Insulated terminal lugs
- *7 The output of all HFE2500 modules are connected in parallel in the Rack

SAFETY APPROVALS

UL62368-1 and CSA22.2 No.62368-1 - UL Recognized. C-UL for Canada

IEC 62368-1 - CB Test Report and Certificate.

EN 62368-1 - TUV Mark, CE Mark.

Marking by the CE Symbol indicates compliance to the Marking of the CE symbol indicates compliance to the EMC Directive, and the Low Voltage Directive and RoHS Directive of the European Union.

A "Declaration of Conformity" in accordance with the preceding directives and standards has been made and is on file at our EU representative: TDK-Lambda Germany GmbH, Karl-Bold-Str. 40, D-77855 Achern.

A "Declaration of Conformity" may be accessed via company website www.emea.tdk-lambda.com/manual

All Models of HFE and RFE series are professional equipment and are not intended for sale to the general public.

OVERCURRENT PROTECTION:

A readily accessible branch circuit over current protective device rated 30A max. per each input must be incorporated in the building wiring. The protective device must disconnect both supply line simultaneously.

FUSES

There are no fuses in the HFE2500-S1U rack.

Multiple power source: Caution Shock hazard- all power sources shall be disconnected before servicing to avoid shock hazard.

SYMBOLS



CAUTION Risk of Electrical Shock.



Instruction manual symbol. The instrument will be marked with this symbol when it is necessary for the user to refer to the instruction manual.



Indicates hazardous voltage.



This symbol indicates the presence of a hot surface or component. Touching this surface could result in bodily injury.



Indicates ground terminal.



Protective earth; protective ground. Indicates the terminal which is intended for connection to an external conductor for protection against electric shock in case of a fault.



All power sources shall be disconnected before servicing to avoid shock hazard.

L1

Indicates first Line supply terminal

L2/N

Indicates second Line or Neutral supply terminal

WARNING


Denotes hazard. An attention to a procedure is called. Not following the procedure correctly could result in personal injury. A WARNING sign should not be skipped and all indicated conditions must be fully understood and met.

CAUTION

Denotes hazard. An attention to a procedure is called. Not following the procedure correctly could result in damage to the equipment.

1. REAR PANEL CONNECTIONS AND CONTROLS


Fig 1.1 Rear view of HFE2500-S1U series

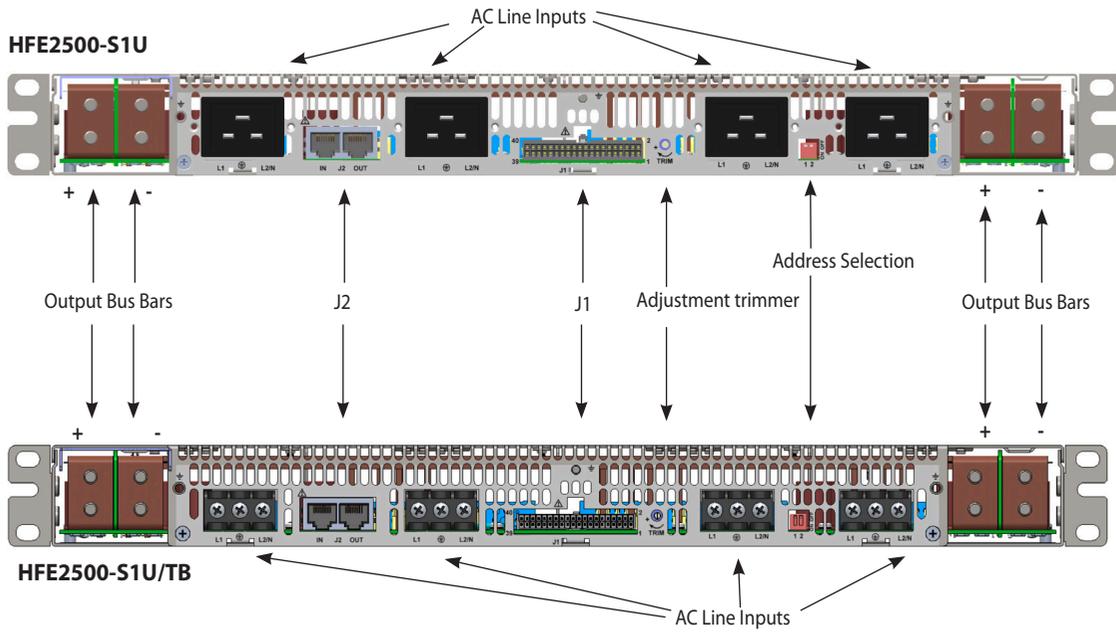

1.1. J1 Connector for Control and Monitoring

Mating for J1 Control Plug (provided) or custom made plug/ cable should be inserted to J1 for proper operation of HFE2500 rack. Refer to Chapter 3 for connection diagrams.

PLEASE VERIFY J1 IS PROPERLY PLUGGED IN. ENSURE THAT THERE IS NO MECHANICAL STRESS ON J1 CONNECTOR.

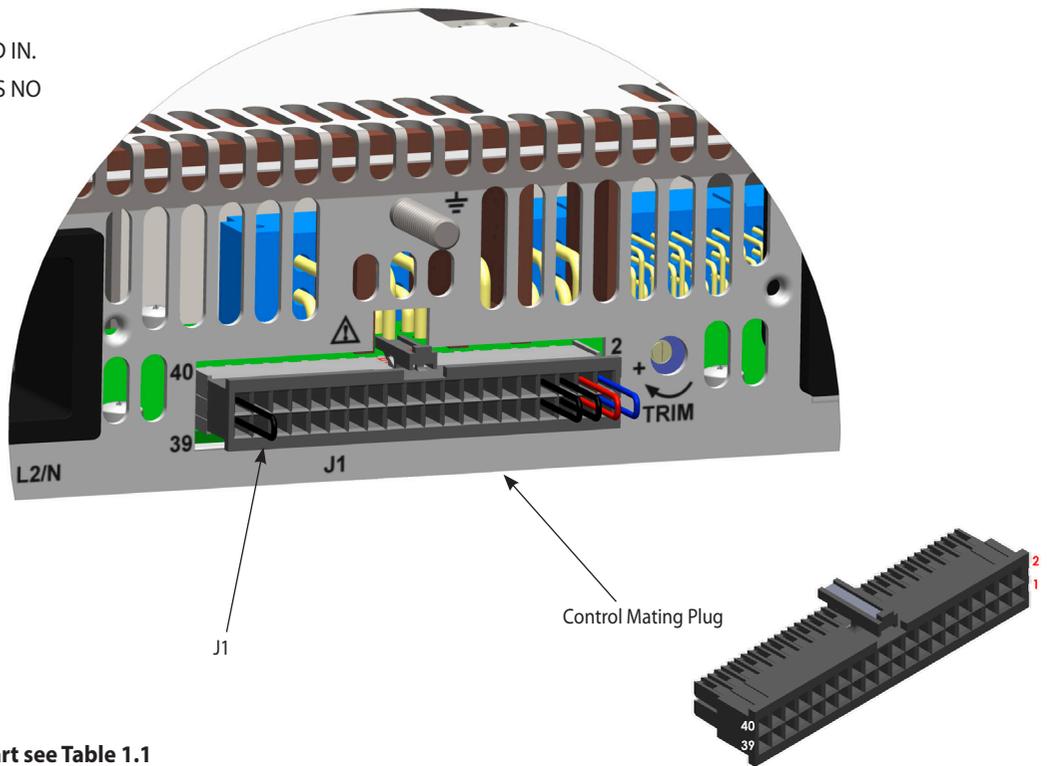

J1 Pin Allocation Chart see Table 1.1



J1 connector description: P/N: IPL1-120-01-S-D-RA-K (SAMTEC)
Mating Plug description: P/N: IPD1-20-D-K (SAMTEC)

Table 1.1 J1 Connector Pin Allocation Chart


Pin #	Name	Description	Pos. #	Control plug J1	Referenced to
1,10	-SENSE	Negative sense Connected to –LS for local sensing, or –V on Load side.	All	Short	
2	-LS	Connected to Negative Output bus bar through 3 Ohm resistor.	All		
3	+SENSE	Positive sense Connected to +LS for local sensing, or +V on Load side.	All	Short	
4	+LS	Connected to Positive Output bus bar through 3 Ohm resistor.	All		
5	V_PROG	Input (0~5V) referenced to –S. Provides Vout programming by Voltage. Refer to Fig 3.6, 3.7.	All	Short	-SENSE
6	TRIM	Output of Rear Panel potentiometer, for manual adjustment of Output Voltage.	All		-SENSE
7	I_PROG	Input (0-5V) referenced to -S. Provided current limit programming by external voltage. Refer to Fig 3.6.1 and 3.7.1	All	Short	-SENSE
8,9	+5V/V_REF	5V fix output for standard option unit. V_REF for Voltage and Current programming when PMBus option is being used.	All		-SENSE
11	TEMP_ALM_A	Output signal of PS in position A. "LOW" when the internal temperature is within safe limit, "HIGH" approximately 10°C below Thermal shut down. Open Collector (15V Max, sink Current 10mA max)	A		SIGNAL RETURN
12	TEMP_ALM_B	Output signal of PS in position B. Same as 11.	B		SIGNAL RETURN
13	TEMP_ALM_C	Output signal of PS in position C. Same as 11.	C		SIGNAL RETURN
14	TEMP_ALM_D	Output signal of PS in position D. Same as 11.	D		SIGNAL RETURN
15		NOT CONNECTED			
16	AC_FAIL_A	Output signal of PS in position A. "LOW" when the input voltage is 85Vac<Vin<270Vac, "HIGH" when the input voltage is 85Vac>Vin or Vin>270Vac. Open Collector (15V Max, sink Current 10mA max)	A		SIGNAL RETURN
17	AC_FAIL_B	Output signal of PS in position B. Same as 16.	B		SIGNAL RETURN
18	AC_FAIL_C	Output signal of PS in position C. Same as 16.	C		SIGNAL RETURN
19	AC_FAIL_D	Output signal of PS in position D. Same as 16.	D		SIGNAL RETURN
20		NOT CONNECTED			
21	DC_OK_A	Output signal of PS in position A. "LOW" when the output voltage is higher than 85~95% of Vout setting. Open Collector (15V Max, sink Current 10mA max)	A		SIGNAL RETURN
22	DC_OK_B	Output signal of PS in position B. Same as 21.	B		SIGNAL RETURN
23	DC_OK_C	Output signal of PS in position C. Same as 21.	C		SIGNAL RETURN
24	DC_OK_D	Output signal of PS in position D. Same as 21.	D		SIGNAL RETURN
25		NOT CONNECTED			
26 37 40	SIGNAL RETURN	Reference for: ENABLE, INHIBIT, TEMP ALARM, AC FAIL, DC OK, +12V AUX, SCL, SDA, SMB ALERT. The SIGNAL RETURN is isolated from the output.	All		
27	INHIBIT_A	Input for PS in position A. Turns OFF the Main Output by electrical signal or dry contact. "SHORT" or 0~0.6V – Output OFF. "OPEN" or 2~15V – Output ON.	A		SIGNAL RETURN
28	INHIBIT_B	Input signal for PS in position B. Same as 27.	B		SIGNAL RETURN
29	INHIBIT_C	Input signal for PS in position C. Same as 27.	C		SIGNAL RETURN
30	INHIBIT_D	Input signal for PS in position D. Same as 27.	D		SIGNAL RETURN
31	NOT USED	NOT CONNECTED			
32	PS_EXIST_A	Output signal of PS in position A. SHORT to Signal Return when PS is inserted into the Rack.	A		SIGNAL RETURN
33	PS_EXIST_B	Output signal of PS in position B. Same as 32.	B		SIGNAL RETURN
34	PS_EXIST_C	Output signal of PS in position C. Same as 32.	C		SIGNAL RETURN
35	PS_EXIST_D	Output signal of PS in position D. Same as 32.	D		SIGNAL RETURN
36	NOT USED	NOT CONNECTED			
38	+12V_AUX	Output. Auxiliary supply 11.2~12.5VDC. Not affected by any signal or fail state.			SIGNAL RETURN
39	ENABLE	Input for entire rack. Turns ON the Main Output by electrical signal or dry contact. "SHORT" or 0~0.6V – Output ON. "OPEN" or 2~15V – Output OFF.	All	Short	SIGNAL RETURN

1.2. J2 Pin Allocation Chart

J2 connector (RJ45 type) is used for parallel connection of two Racks.

Table 1.2

IN		OUT	
Pin #	Name	Pin #	Name
1	CURRENT SHARE	1	CURRENT SHARE
2	I_PROG	2	I_PROG
3	V_PROG	3	V_PROG
4	-SENSE	4	-SENSE
5	SCL (PMBus)	5	SCL (PMBus)
6	SIGNAL_RETURN	6	SIGNAL_RETURN
7	SDA (PMBus)	7	SDA (PMBus)
8	SMB_ALERT	8	SMB_ALERT

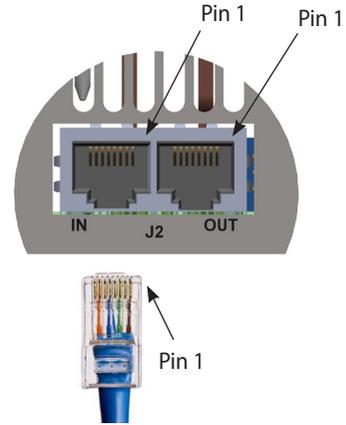

1.3. Output Bus Bar Connections

The HFE2500-S1U has two identical Output Bus Bar connections on both sides of Rear Panel. They are connected in parallel in the Rack.

Each or both of them can be used for output connections.

ATTENTION: Maximum allowable current for each pair of Output Bus Bars – 320A. Total Output Current: 640A

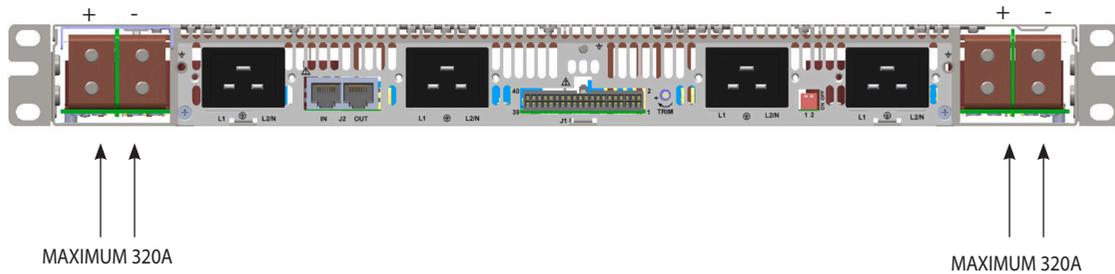


Fig 1.3a Output Bus-Bars.



Fig 1.3b Installation of Output Bus-Bars Protection Cover.

1.4. Output Voltage adjustment Trimmer

Output Voltage may be adjusted by the Rear Panel Trimmer.

Model	HFE2500-12	HFE2500-24	HFE2500-48
Output voltage range (V)	9.6~13.2	19.2~29.0	38.4~58




“NOTE - manual trim setup not to be used with /S PMBus versions. See section 3.7 Setup Output Voltage programming by PMBus

1.5. PMBus address

Each slot in the Rack (see fig-2.2) has its own address for PMBus communication. Valid only if /S option power supply is being used. In case parallel connection of two racks is used, SW1 located at the rear panel is used to differentiate between addresses for the same slots. see Table 1.5.

Position In Rack	SW1-1	SW1-2	Address (Bin)
A	ON	ON	0010000
B			0010010
C			0010100
D			0010110
A	OFF	OFF	0010001
B			0010011
C			0010101
D			0010111



2. RACK MECHANICAL FEATURES

2.1. Insertion and extraction of the PS

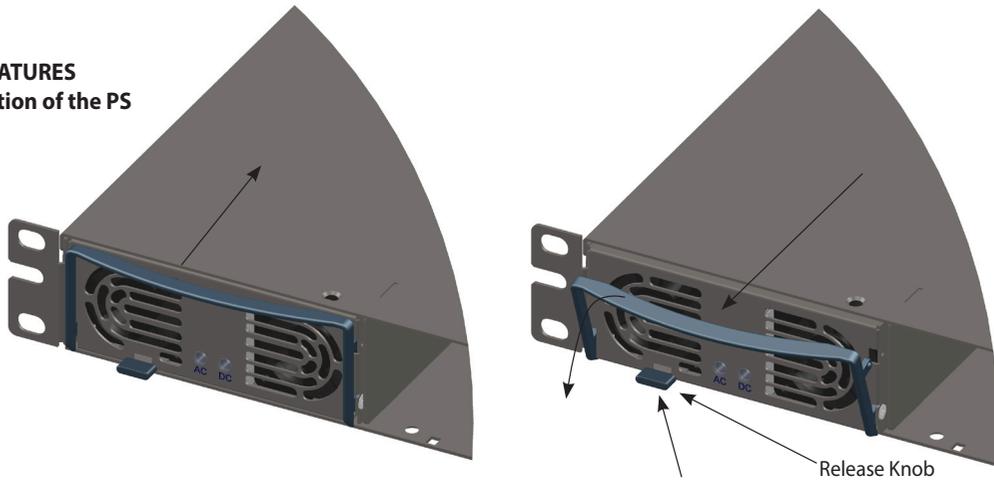


Fig 2.1

To insert the power supply, push unit into the rack with extraction handle closed.

To extract power supply, elevate the release knob and pull the extraction handle simultaneously.

CAUTION

When inserting a power supply into the rack, do not use unnecessary force; slamming the power supply into the rack can damage the connectors on the rear of the supply and inside the rack.

2.2. Definition of Power Supplies Position

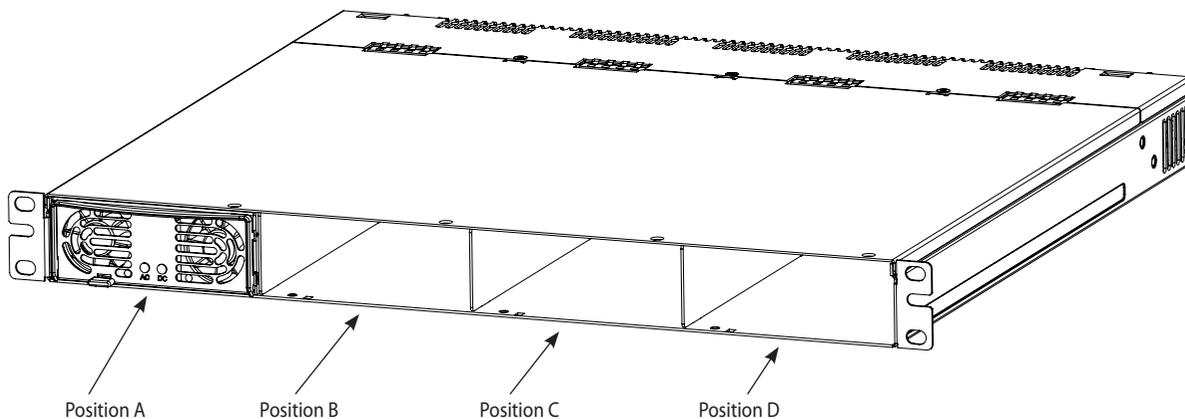


Fig 2.2 Power supply positions

2.3 Keying Option to define the Rack's Voltage

Keying Option can be installed to ensure that only the correct Power Supply can be inserted into the Rack. The Key Option consists of two parts: Power Supply Key (one per unit Fig 2.3a) and Rack Keys (5 per Rack Fig 2.3b). Power Supply Key and Rack Keys should be fixed (by Flat head screws M3x6) in position corresponding to Output Voltage.

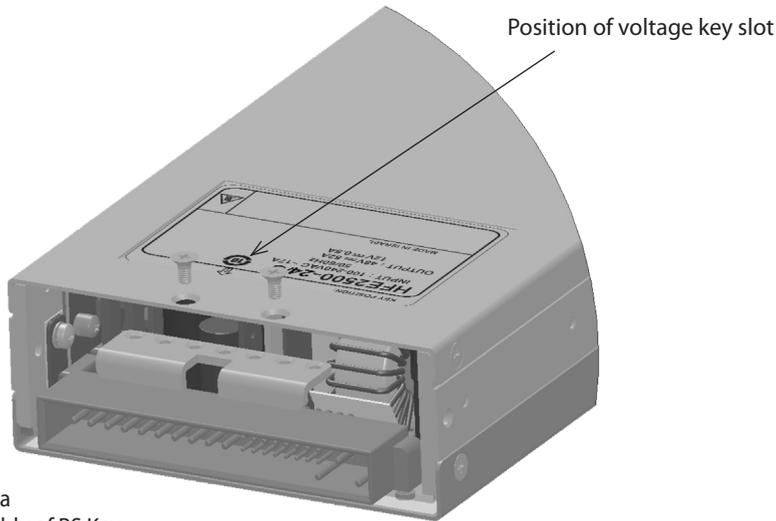


Fig 2.3a
Assembly of PS Key

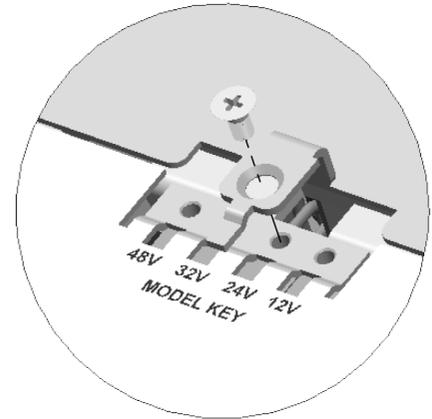


Fig 2.3b
Assembly of Rack Key (Rack Top View)

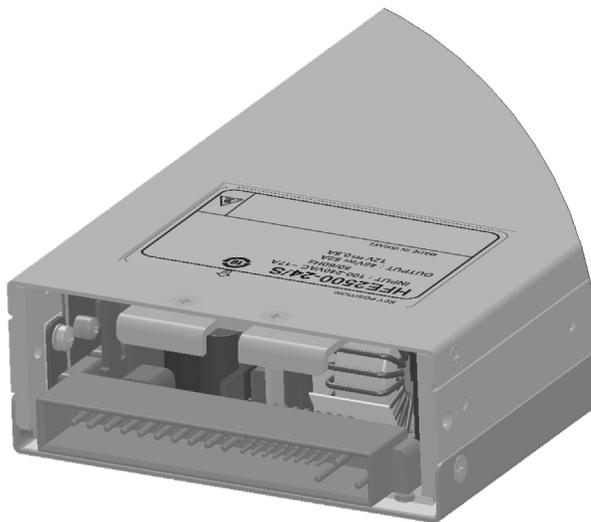


Fig 2.3c
Example 24V Model with assembled Key.

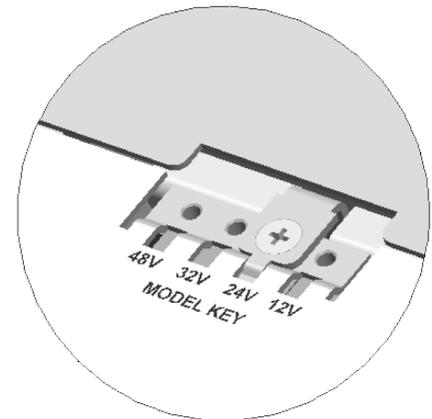


Fig 2.3d
Example Rack Key assembled for 24V power supplies

2.4 Blank Panel

In case all positions of the Rack are not filled with supplies, Blank Panel should be used to ensure proper Air Flow. It is recommended to interleave supplies and Blank Panels wherever possible.

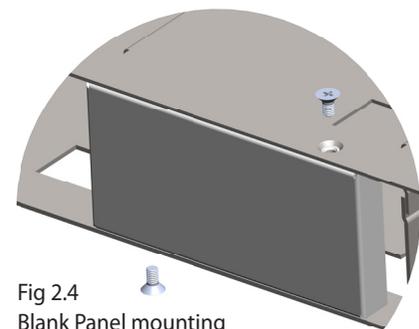


Fig 2.4
Blank Panel mounting

2.5 Rack mounting options

Rack can be mounted into 19" Rack Cabinet which suits both USA and European Standards:



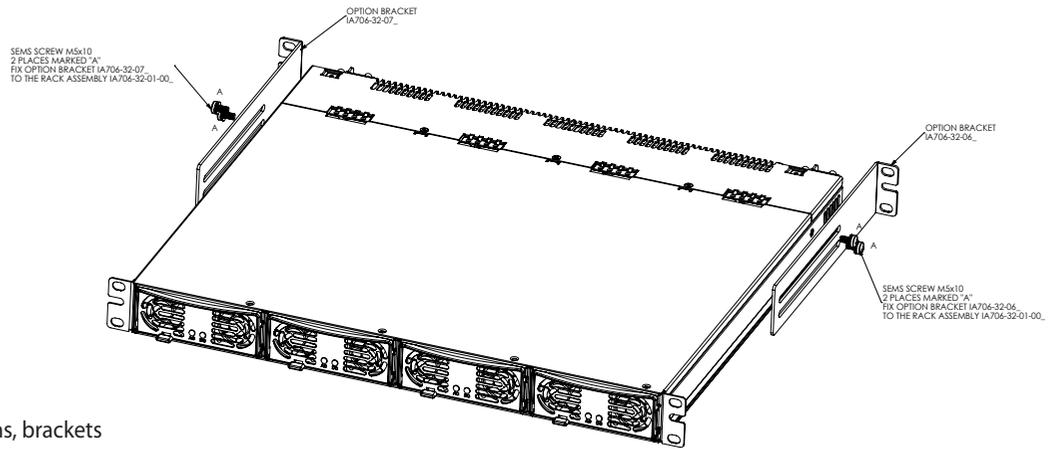


Fig 2.5 Mounting options, brackets and screws are included.

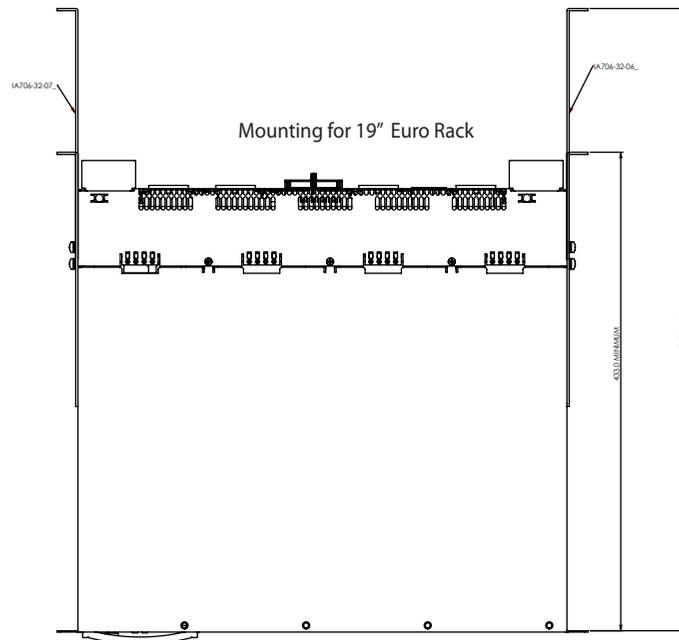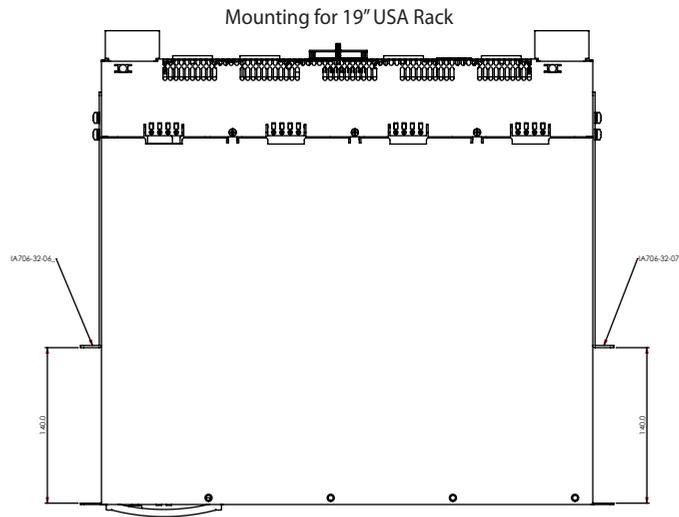

3. Typical applications

3.1 Basic connection

For basic connection, the supplied Control Plug should be inserted to J1.

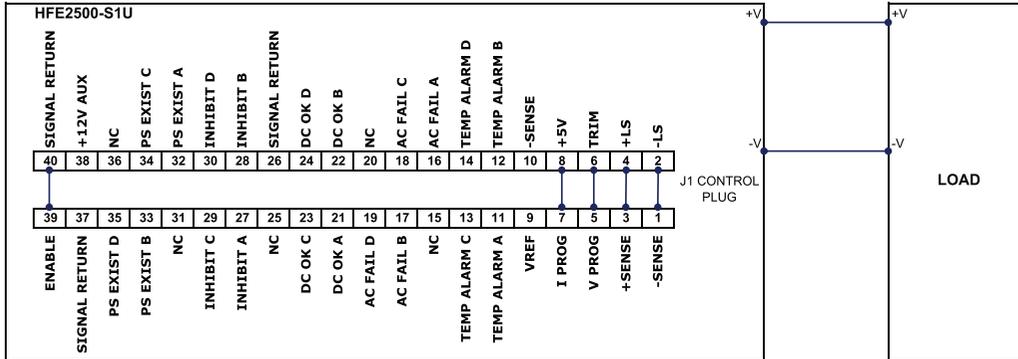


Fig 3.1 Basic connection diagram.

3.2 Remote sensing

ATTENTION:

1. Maximum voltage drop on load wires: HFE2500-12: 0.25V/wire, HFE2500-24: 0.5V/wire, 48: 1V/wire.
2. Twisted wires should be used for Remote Sense connection.
3. If Remote Sensing is used, do not break Main Output connection.

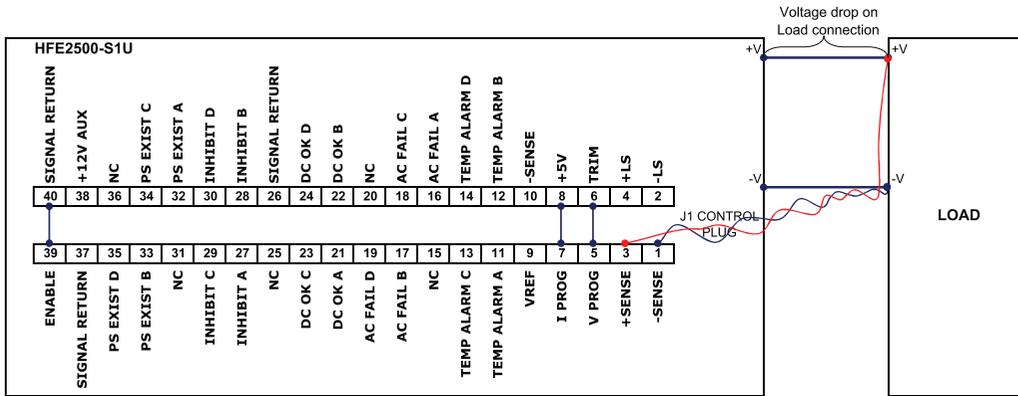


Fig 3.2 Remote Sensing connection diagram

3.3 On/Off control for the entire Rack

Switch closed: Output ON

Switch open: Output OFF

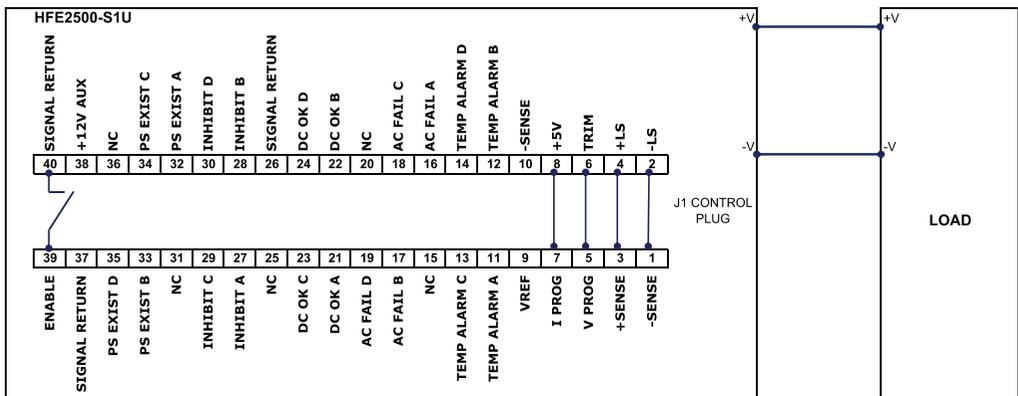


Fig 3.3 Entire rack On/Off control diagram.

3.4 Individual On/Off control for each PS

Switch closed: Output OFF
Switch open: Output ON

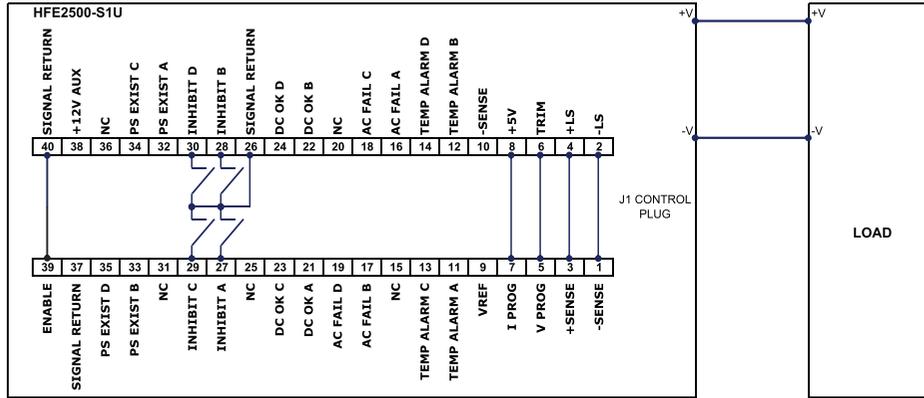


Fig 3.4 individual units On/Off diagram.

3.5 Supervisory signals.

Following signals are accessible from each power supply at J1:

- DC OK
- AC FAIL
- PS EXIST
- TEMP ALARM

These signals are Open Collector type (Max 15V, 10mA), isolated from Output and referenced to SIGNAL RETURN.

Fig 3.5 presents example of the typical connection for DC OK signal of power supply in position A.

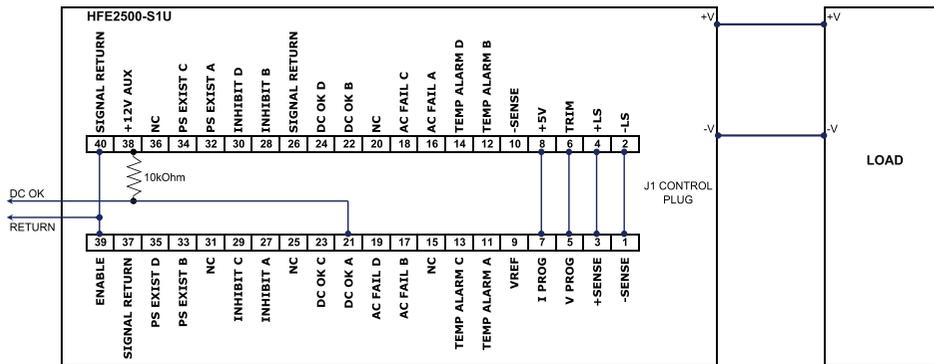


Fig 3.5 "DC OK" signal connection diagram for Power Supply in Position A.

3.6 Output Voltage programming by External Voltage.

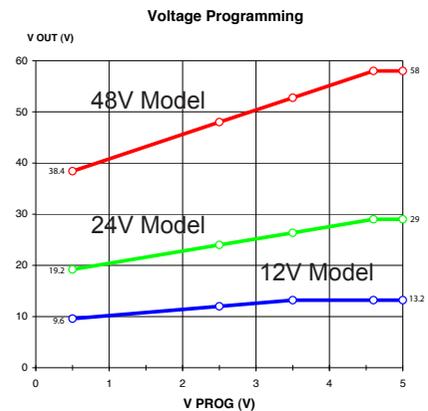
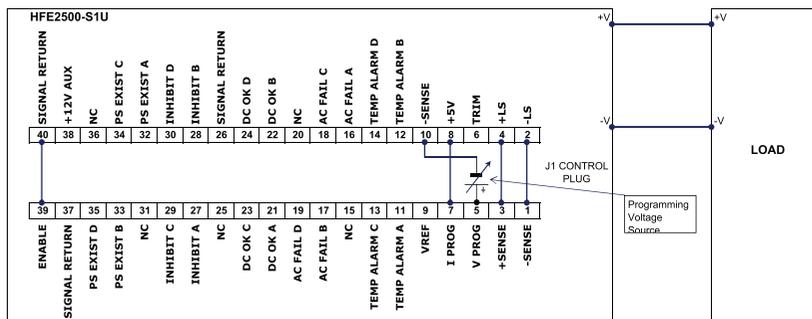


Fig 3.6 Output Voltage programming by External Voltage.

3.6.1 Output Current programming by External Voltage.

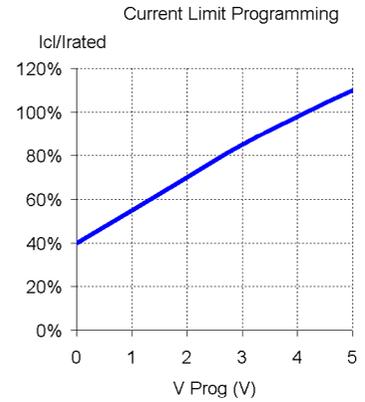
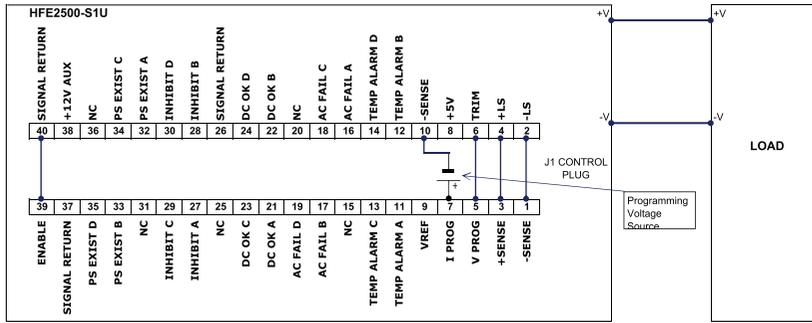


Fig 3.6.1 Output Current programming by External Voltage.

3.7 Output Voltage programming by PMBus.

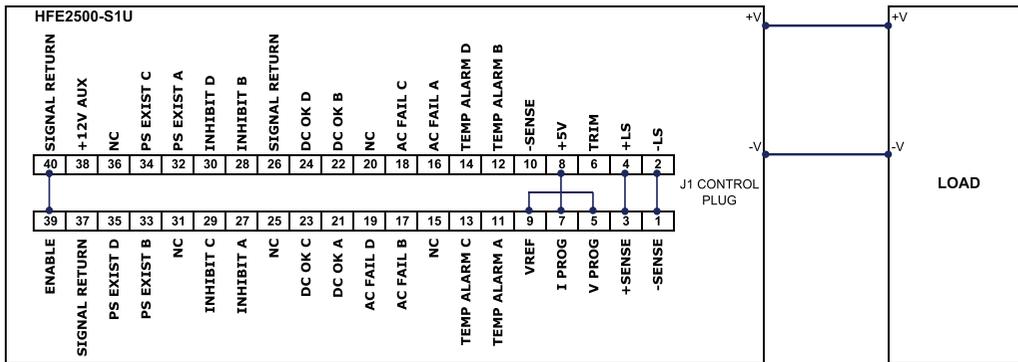


Fig 3.7 Output Voltage programming by PMBus

3.7.1 Output Current programming by PMBus.

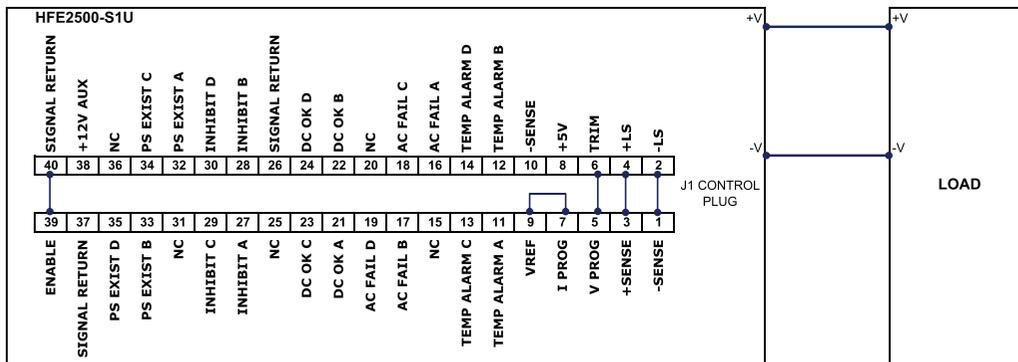


Fig 3.7.1 Output Current programming by PMBus

3.8 PMBus Host connection

To connect the rack to the Host computer, connect communication cable (refer to table 3.8 for cable connection) between J2 and computer:

Table 3.8 PMBus Cable.

Signal Name	From pin	Wire (AWG)	To Host	Note
SCL	5	22~24	-	Twisted pair
SIGNAL_RETURN	6	22~24	-	
SDA	7	22~24	-	
SMB_ALERT	8	22~24	-	Twisted pair

RJ45 Shielded Male Connector should be used.

Cable must be shielded; only connector shield is connected to cable shield.

3.9 Parallel connection of two Racks

To connect two Racks in parallel for higher Output Current:

- Connect Main Output (Bus-Bars) in parallel. Make the connections as short as possible and with equal length.
- Connect Sense (twisted pairs) to Load point.
- Connect J2 connector of both Racks by Cable (for cable construction see Table 3.9).
- Slave - Disconnect connection between VPROG and TRIM (J1.5 and J1.6).
- Slave - Switch SW1 to "OFF" position (applicable for HFE2500-xx /S PMBus option). For addressing refer to Table 1.5.
- Output Voltage can be adjusted by the trimmer on Master Rack.

Table 3.9 Rack Interconnection Cable.

Signal Name	From pin	Wire (AWG)	To Pin	Note
CURRENT SHARE	1	22~24	1	Twisted pair
V_PROG	3	22~24	3	Twisted pair
-SENSE	4	22~24	4	
SCL	5	22~24	5	Twisted pair
SIGNAL_RETURN	6	22~24	6	
SDA	7	22~24	7	Twisted pair
SMB_ALERT	8	22~24	8	

RJ45 Shielded Male Connectors should be used.

Cable must be shielded; only connector shields are connected to cable shield.

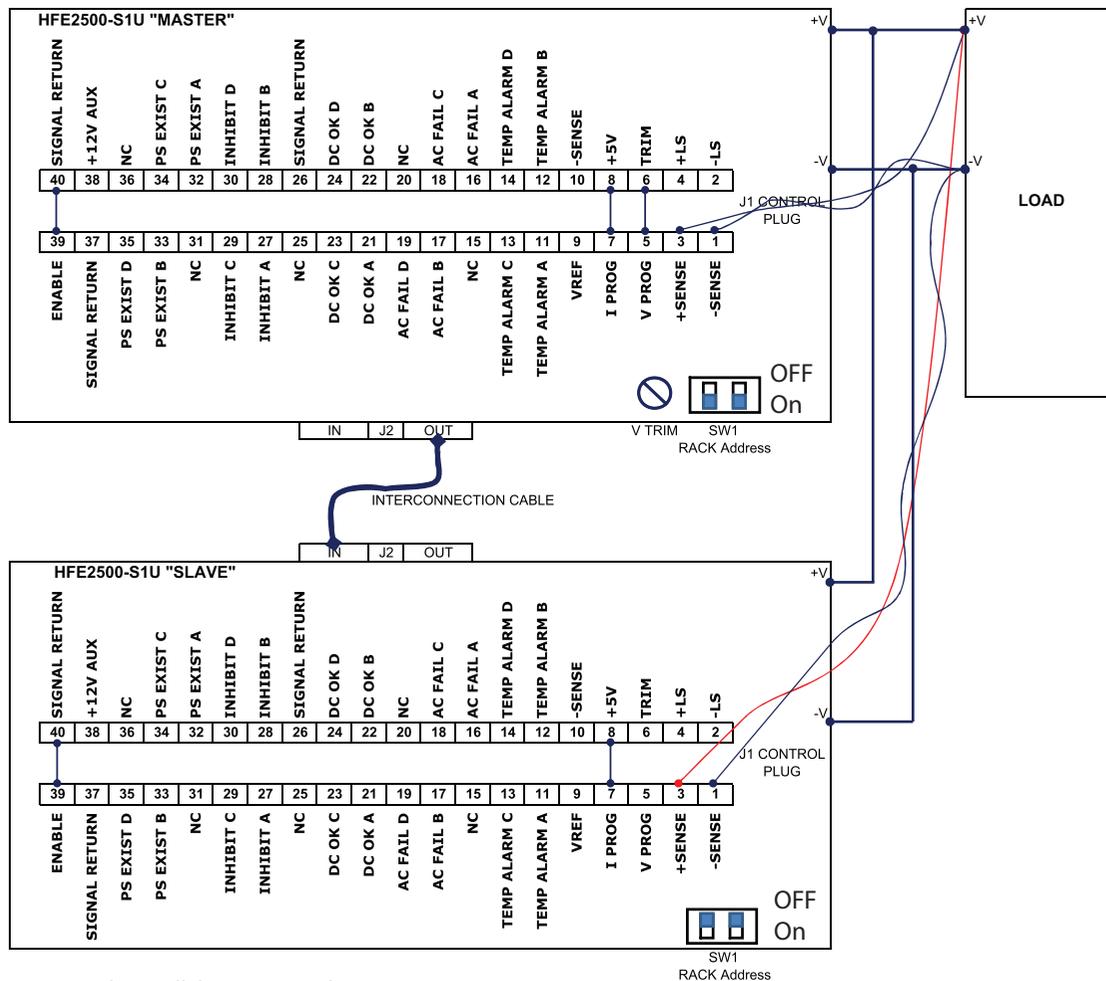


Fig 3.9 Racks parallel connection diagram.

*Note: For PMBUS OPTION in the master rack

1. Disconnect Pin 5&6
2. Connect Pin 5&9

3.10 Series Rack connection

Up to 2 racks with the same number of power supplies and rating (voltage and current) can be used to increase the output voltage.

To connect two Racks in series:

- Connect Main Output (bus bars) in series;
- Connect Sense (twisted) to Load point (as shown in fig-3.10), or use Local Sensing using supplied Control Plugs.
- In case PMBus is used, Connect J2 connector of both Racks by Interconnect Cable for Serial connection (for cable construction see Table 3.10);

CAUTION

Do not use Cable as of Table 3.9.

- On one Rack put Switch SW1 to OFF position (only for HFE2500-xx /S PMBus option). For Addressing see Table 1.5;
- Output Voltage can be adjusted by potentiometers on both Racks.

Table 3.10 Rack Interconnection Cable for Serial connection.

Signal Name	From pin	Wire (AWG)	To Pin	Note
CURRENT SHARE	1	Open	1	Do not connect!
V_PROG	3	Open	3	Do not connect!
-SENSE	4	Open	4	
SCL	5	22~24	5	Twisted pair
SIGNAL_RETURN	6	22~24	6	
SDA	7	22~24	7	Twisted pair
SMB_ALERT	8	22~24	8	

RJ45 Shielded Male Connectors should be used. Cable must be shielded; only connector shields are connected to cable shield. Diodes should be connected in parallel with each unit output to prevent reverse voltage. Each diode should be rated to at least the power supply rated output voltage and output current.

WARNING

Do not connect -SENSE and any signals referenced to -SENSE between two Racks. Only signals referenced to SIGNAL RETURN can be connected between Racks.


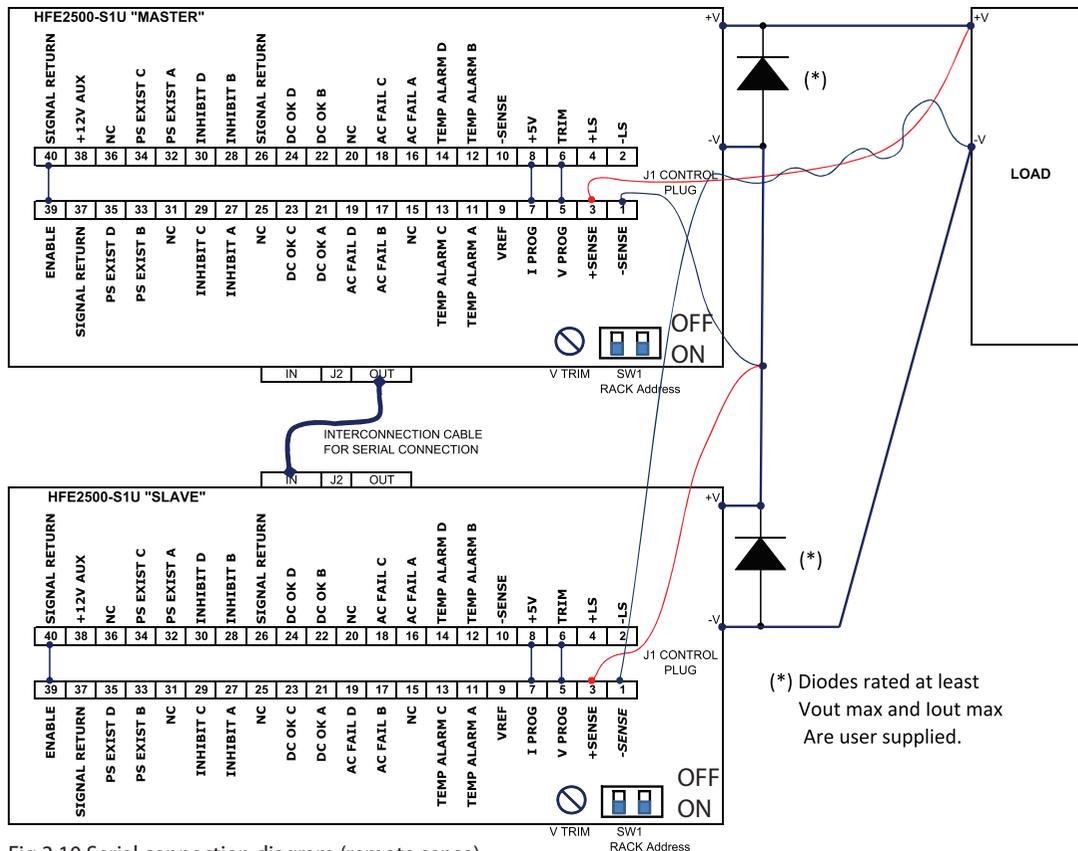


Fig 3.10 Serial connection diagram (remote sense).

HFE2500 - S1U Outline Drawing

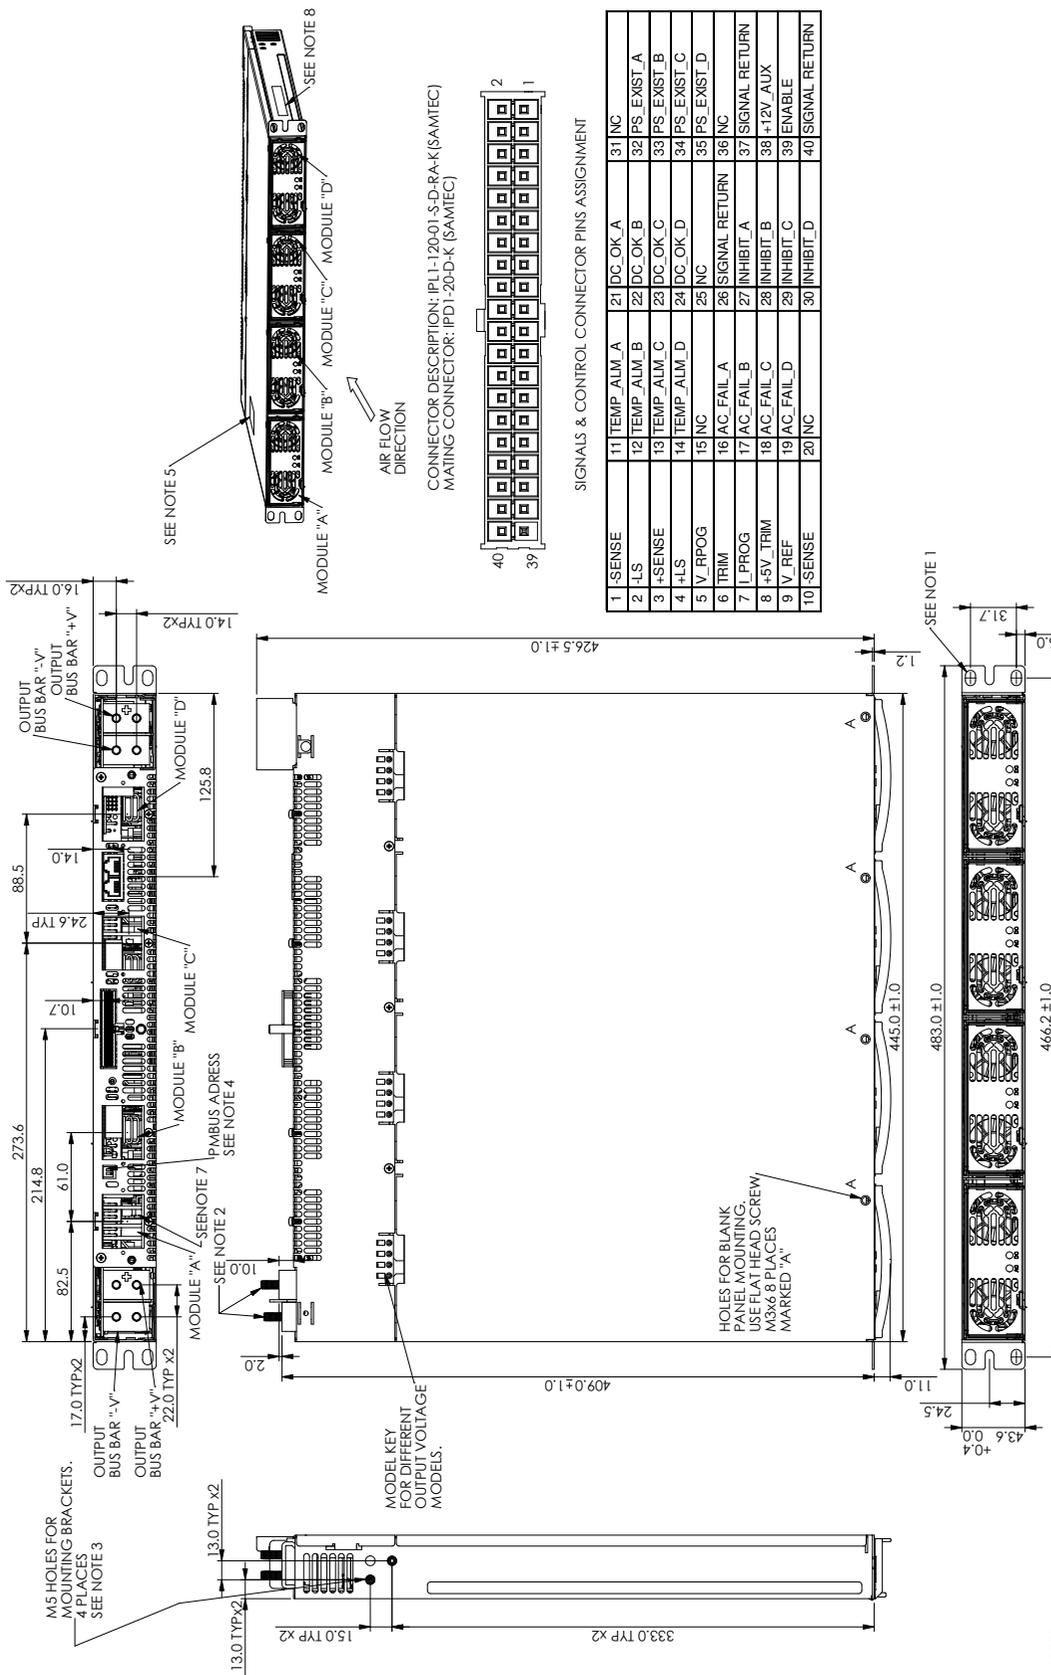


SIGNALS & CONTROL CONNECTOR PINS ASSIGNMENT

1	-SENSE	11	TEMP_ALM_A	21	DC_OK_A	31	NC
2	-LS	12	TEMP_ALM_B	22	DC_OK_B	32	PS_EXST_A
3	+SENSE	13	TEMP_ALM_C	23	DC_OK_C	33	PS_EXST_B
4	+LS	14	TEMP_ALM_D	24	DC_OK_D	34	PS_EXST_C
5	V_RPOG	15	NC	25	NC	35	PS_EXST_D
6	TRIM	16	AC_FAIL_A	26	SIGNAL_RETURN	36	NC
7	PROG	17	AC_FAIL_B	27	INHIBIT_A	37	SIGNAL_RETURN
8	+5V_TRIM	18	AC_FAIL_C	28	INHIBIT_B	38	+12V_AUX
9	V_REF	19	AC_FAIL_D	29	INHIBIT_C	39	ENABLE
10	-SENSE	20	NC	30	INHIBIT_D	40	SIGNAL_RETURN


- NOTES:
1. MOUNTING HOLES FOR RACK 19". USE M6x12 SCREWS TO FIX THE UNIT TO A RACK.
 2. USE NUT FLAT WASHER AND SPRING WASHER FOR LOAD WIRES FIXING. USE LUG STUD M6 FOR LOAD WIRES. RECOMMENDED TORQUE: 42-54 Kgf.cm.
 3. TO FIX THE MOUNTING BRACKET TO THE CHASSIS USE M5x10 SEMS. SCREWS RECOMMENDED TIGHTENING TORQUE 27-31 Kgf.cm. SCREWS MUST NOT PENETRATE THE CHASSIS MORE THAN 6.0 mm.
 4. REFER TO INSTRUCTION MANUAL FOR SETTING DETAILS.
 5. MODEL NAME, VOLTAGE AND CURRENT RATING AND SAFETY APPROVALS SYMBOLS WILL BE SHOWN HERE ACCORDING TO THE SPECIFICATION.
 6. THE TEST PACKAGE IS SHOWN WITH 4 HFE2500.
 7. THE IEC INLET TYPE C20.
 8. EU REPRESENTATIVE ADDRESS LABEL.

HFE2500 - S1U-TB Outline Drawing

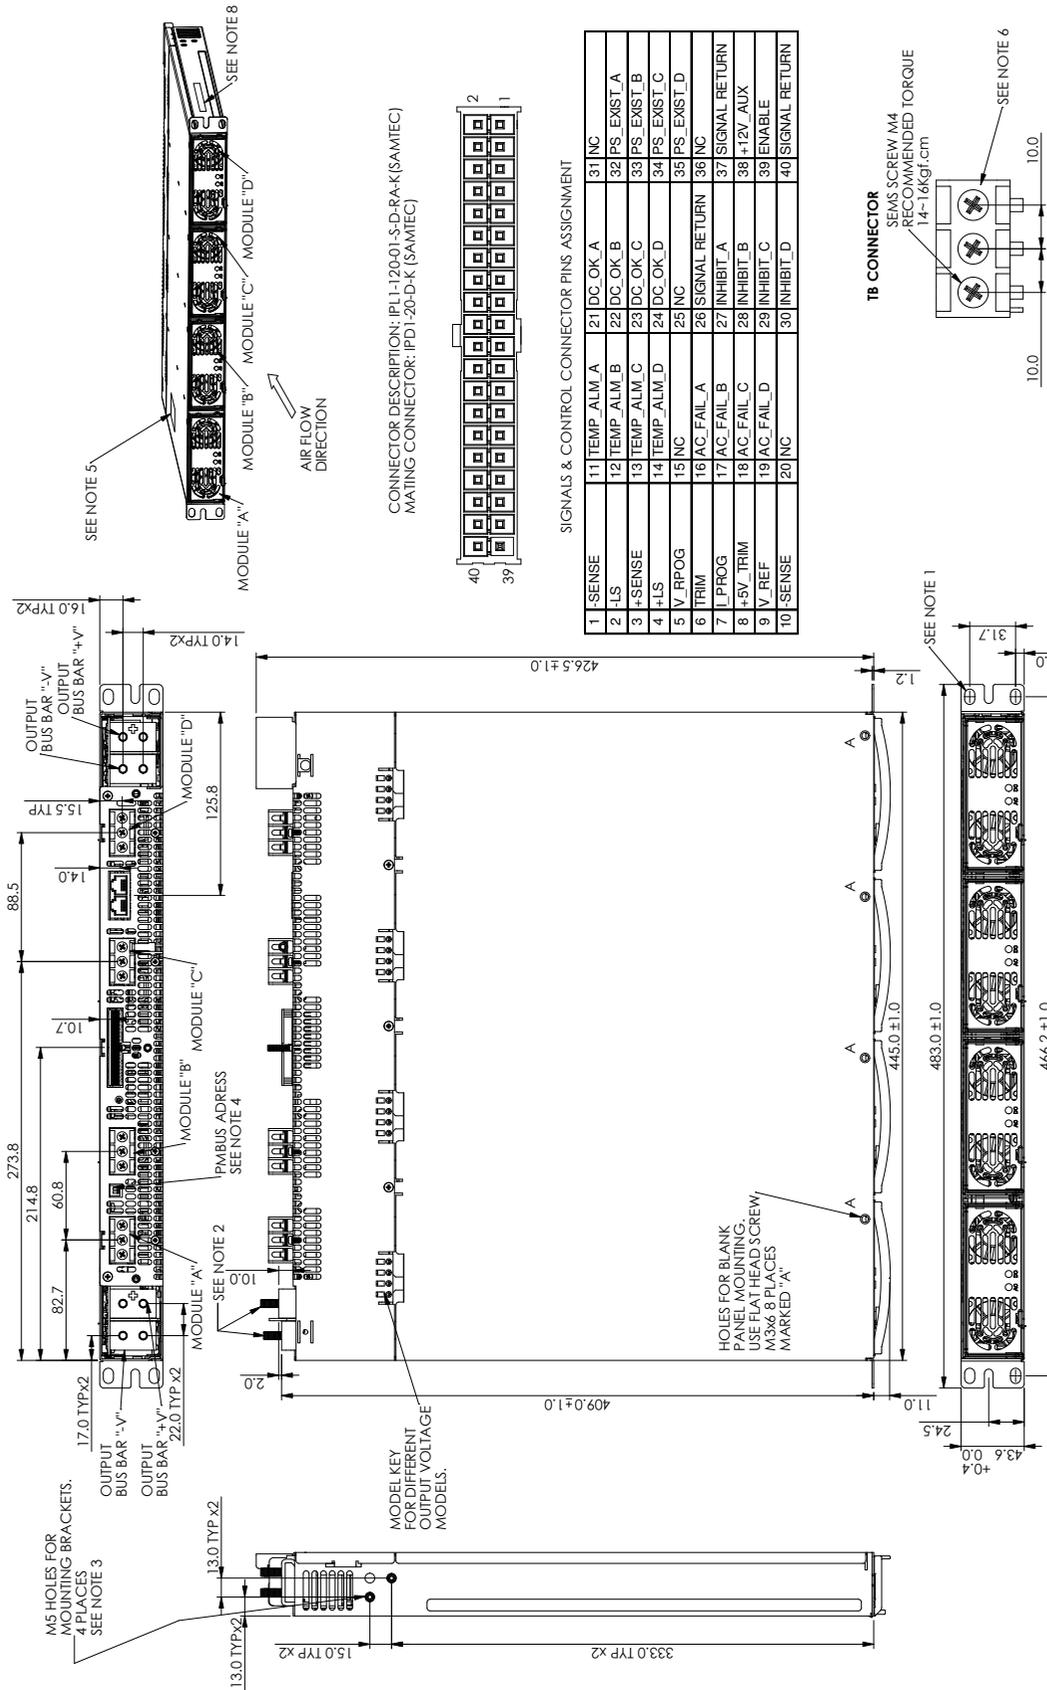

SIGNALS & CONTROL CONNECTOR PINS ASSIGNMENT

1	SENSE	11	TEMP_ALM_A	21	DC_OK_A	31	NC
2	LS	12	TEMP_ALM_B	22	DC_OK_B	32	PS_EXST_A
3	+SENSE	13	TEMP_ALM_C	23	DC_OK_C	33	PS_EXST_B
4	+LS	14	TEMP_ALM_D	24	DC_OK_D	34	PS_EXST_C
5	V_RPOG	15	NC	25	NC	35	PS_EXST_D
6	TRIM	16	AC_FAIL_A	26	SIGNAL_RETURN	36	NC
7	PROG	17	AC_FAIL_B	27	INHIBIT_A	37	SIGNAL_RETURN
8	+5V_TRIM	18	AC_FAIL_C	28	INHIBIT_B	38	+12V_AUX
9	V_REF	19	AC_FAIL_D	29	INHIBIT_C	39	ENABLE
10	SENSE	20	NC	30	INHIBIT_D	40	SIGNAL_RETURN



- NOTES:
1. MOUNTING HOLES FOR RACK 19". USE M6x12 SCREWS TO FIX THE UNIT TO A RACK. WASHER AND SPRING WASHER FOR LOAD WIRES FIXES. USE 11G STUD M6 FOR LOAD WIRES. RECOMMENDED TORQUE: 20-54 g.cm.
 2. TO FIX THE MOUNTING BRACKET TO THE CHASSIS USE M5x10 SEMS SCREWS. RECOMMENDED TIGHTENING TORQUE 27-31Kgf.cm. SCREWS MUST NOT PENETRATE THE CHASSIS MORE THAN 6.0 mm.
 3. REFER TO INSTRUCTION MANUAL FOR SETTING DETAILS.
 4. MODEL NAME, VOLTAGE AND CURRENT RATING AND SAFETY APPROVALS SYMBOLS WILL BE SHOWN HERE
 5. ORDER TO THE SPECIFIC TERMINAL LUGS.
 6. USE ORDERED TERMINAL LUGS.
 7. THE HFE S1U RACK IS SHOWN WITH 4 HFE2500 UNITS INSTALLED.
 8. EU REPRESENTATIVE ADDRESS LABEL.

